INSTRUCTION SHEET

amerlux


AMERLUX/GLOBAL SINGLE CIRCUIT INSTALLATION


689-0005

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.
RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


1. INSPECT TRACK ADAPTOR

INCORRECT POSITION

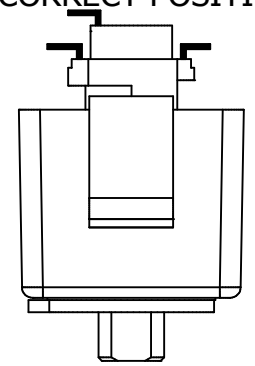

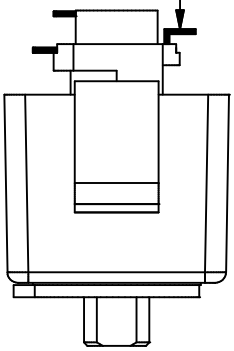


CORRECT POSITION

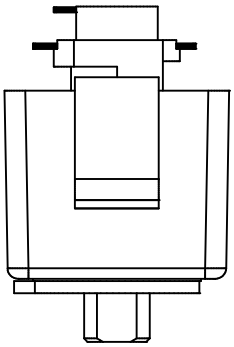


2. INSERT ADAPTOR

INSERT ADAPTER INTO TRACK AS SHOWN
WITH NEUTRAL POLARITY MARK AND
ADAPTER STOP ORIENTED TO THE SAME SIDE.

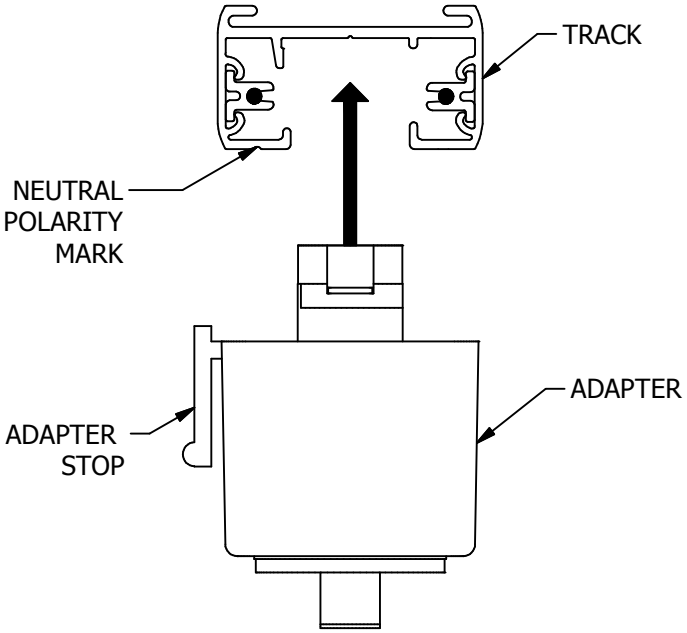

3. ROTATE TO INSTALL

- FULLY SEAT ADAPTER INTO TRACK
- PRESS DOWN ON ADAPTER STOP AS SHOWN
- TURN ADAPTER 90° TO THE RIGHT

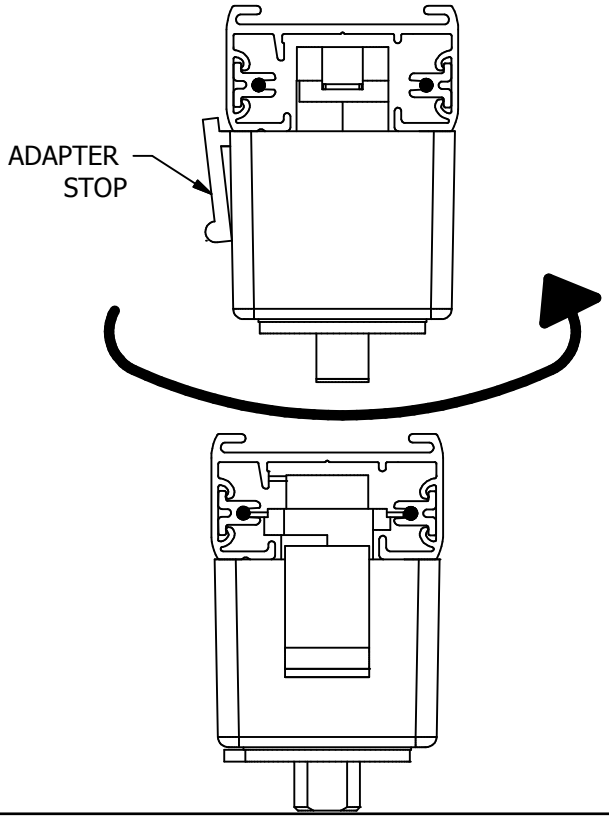

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com