

INSTRUCTION SHEET



ESSENZA-A17/HDL-HP-A17/HSE FRAME INSTALLATION

689-0625


PAGE 1 OF 4

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

CEILING CUTOUT


MODEL	STYLE	CUTOUT
HDL-HP-xx-A17 xx=NC xx=CP xx=IC xx=REM	R-T (Round Trimmed)	Ø4"
	S-T (Square Trimmed)	4"x4"
	R-TL (Round Trimless)	Ø4-1/2"
	S-TL (Square Trimless)	4-1/2"x4-1/2"




MODEL	STYLE	CUTOUT
EZ-xx-A17 xx=NC xx=CP xx=IC xx=REM	T (Trimmed)	Ø4"
	R-TL (Round Trimless)	Ø4-1/2"
	S-TL (Square Trimless)	4-1/2"x4-1/2"

**NOTE: ROUND FRAME INSTALLATION SHOWN.
FOLLOW SAME PROCEDURE TO INSTALL SQUARE FRAME.**


NC ROUND TRIMMED FRAME

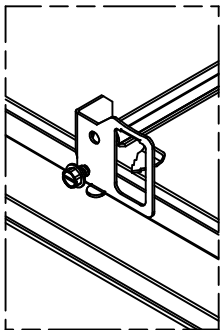


FASTEN TO STRUCTURAL
MEMBER OR T-BAR

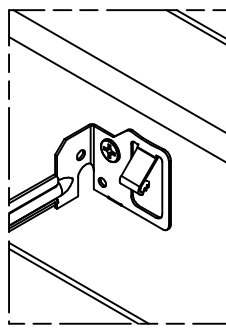


SCREW TO WOOD OR
METAL STRUCTURE

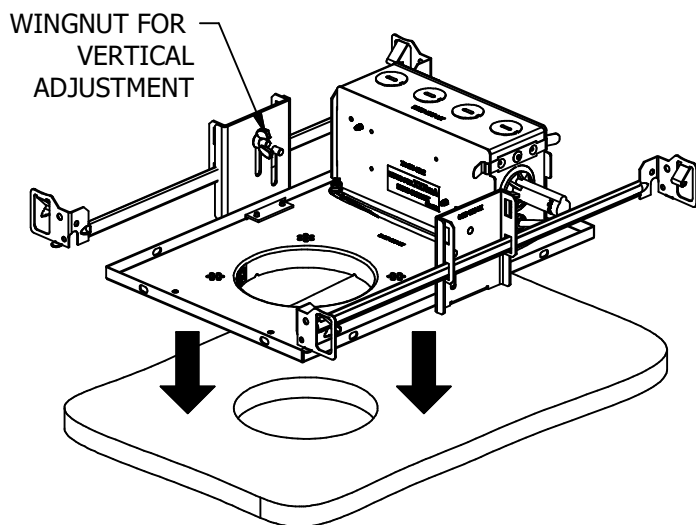


NC ROUND TRIMLESS FRAME

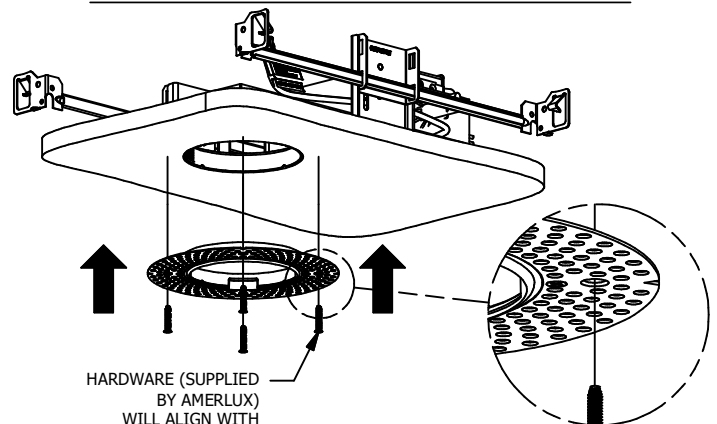

HARDWARE (SUPPLIED
BY AMERLUX)
WILL ALIGN WITH
PERFORATION IN
APERTURE PLATE

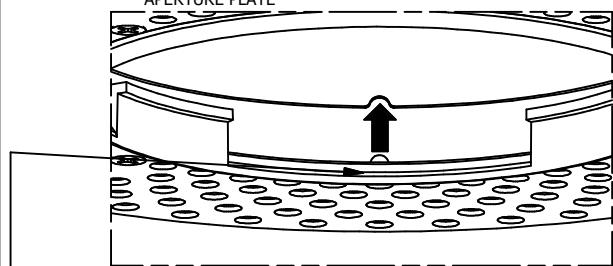

**IMPORTANT NOTE: REST ALIGNMENT MARKERS
WITHIN THE NOTCHES OF APERTURE AS SHOWN.
THIS IS CRITICAL FOR PROPER ALIGNMENT.**

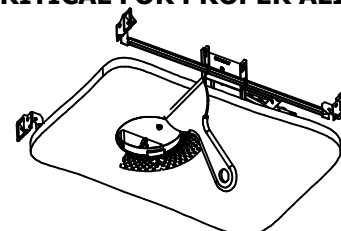

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

**INSTRUCTION
SHEET**



**ESSENZA-A17/HDL-HP-A17/HSE FRAME
INSTALLATION**


689-0625

PAGE 2 OF 4

**WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.
RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.**

CP/IC/AT FRAME

FOR CP/IC/AT FRAME INSTALLATION FOLLOW STEPS FOR THE OPEN FRAME INSTALLATION (SEE PAGE 1).

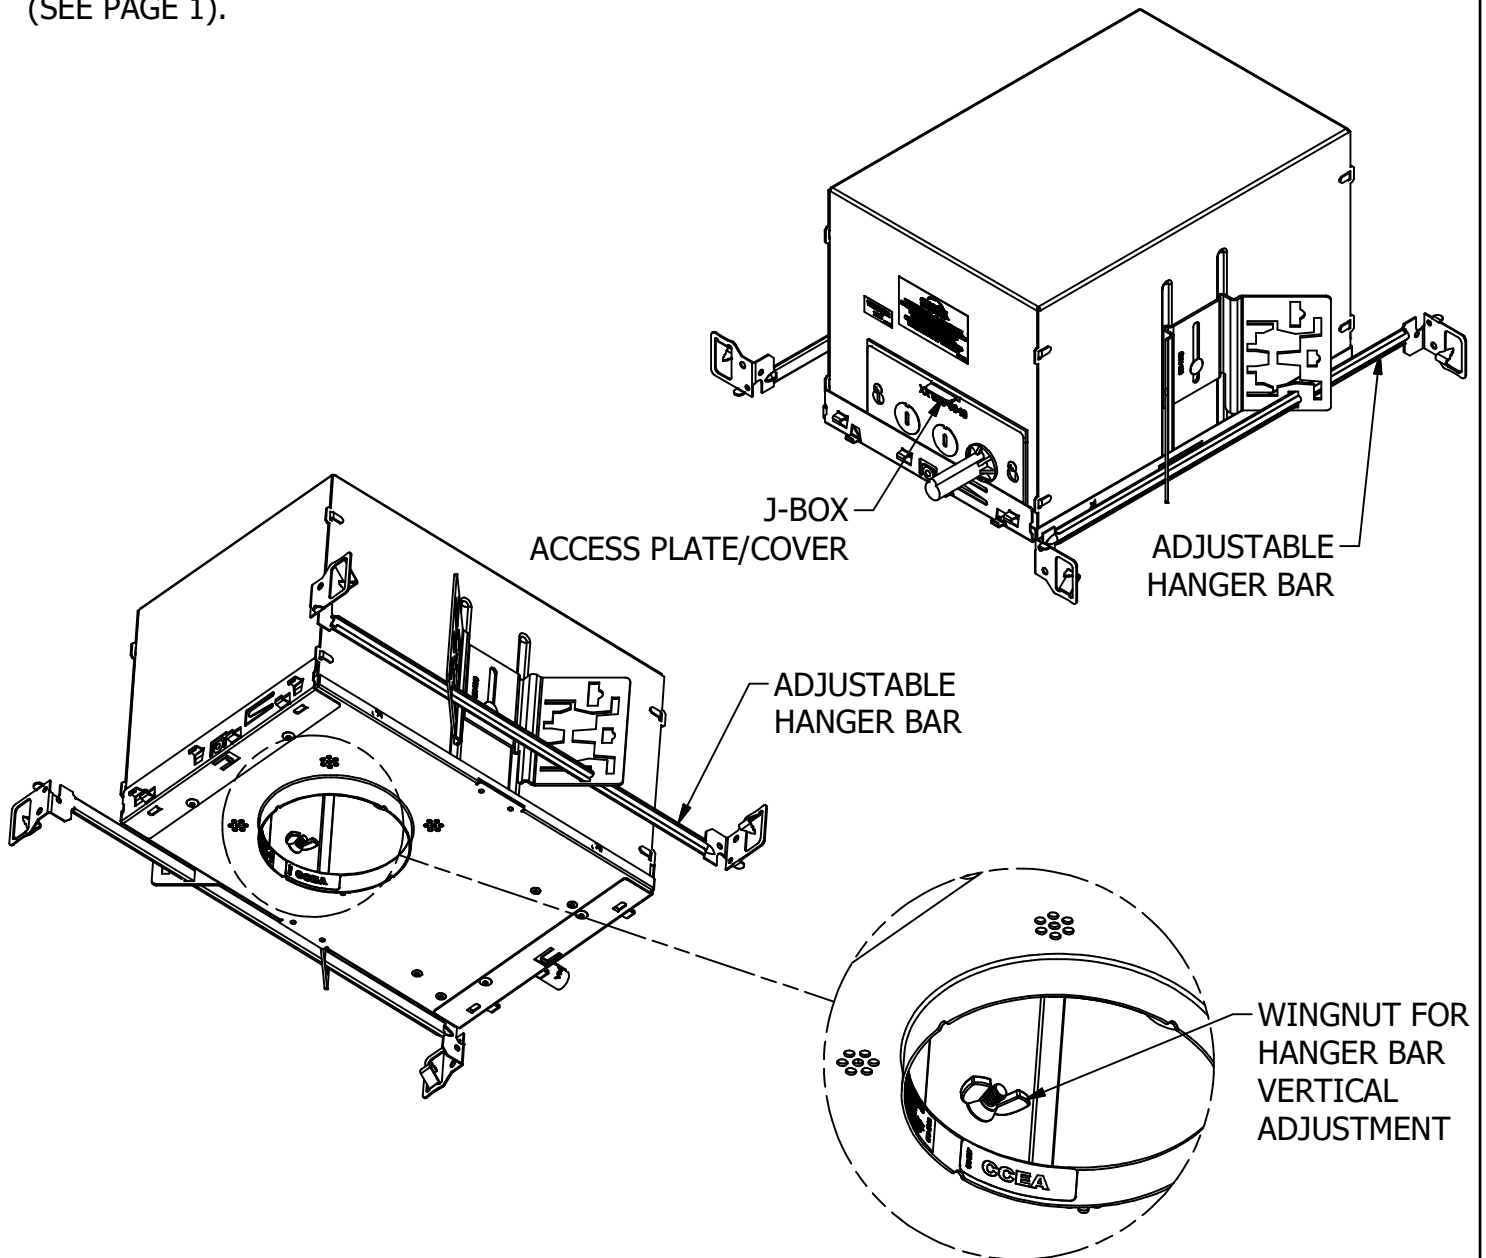

**NOTE: ROUND FRAME INSTALLATION SHOWN.
FOLLOW SAME PROCEDURE TO INSTALL SQUARE FRAME.**

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

INSTRUCTION SHEET



ESSENZA-A17/HDL-HP-A17/HSE FRAME INSTALLATION


689-0625

PAGE 3 OF 4



WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.


REMODELER FRAME

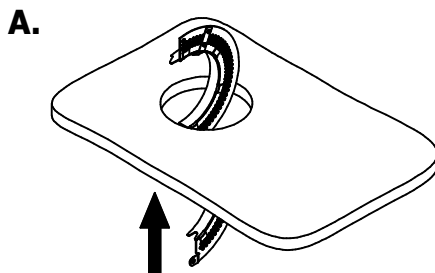



OPEN RING AND INSERT
INTO CEILING, THEN
CLOSE RING AND LOCATE
IN CEILING CUTOUT.

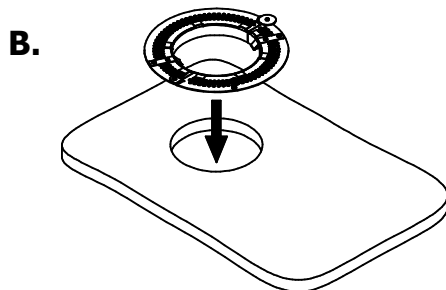


SECURE BY
HAMMERING
2X TABS
INTO CEILING.

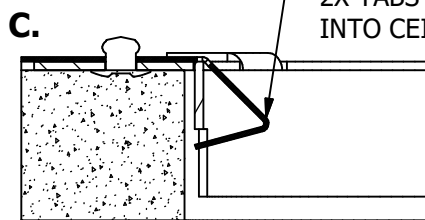


REMODELER TRIMLESS FRAME

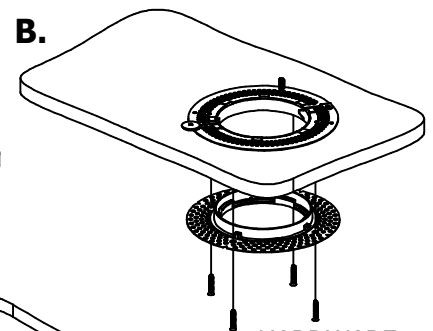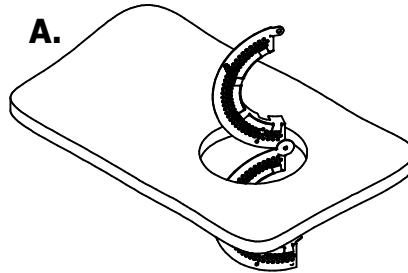

HARDWARE
(SUPPLIED
BY AMERLUX).





REMODELER DRIVER INSTALLATION REMODELER AND REMODELER TRIMLESS FRAMES

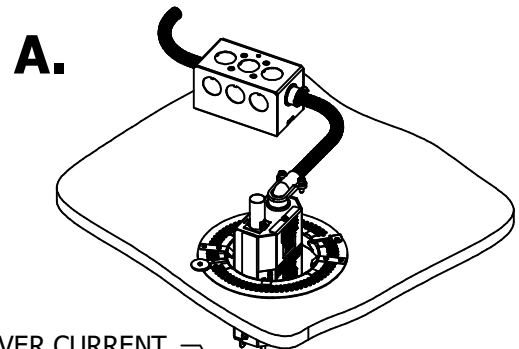

B.

DRIVER CURRENT
LABEL

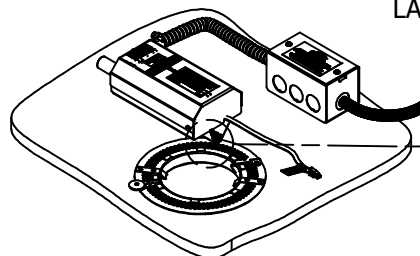

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com

INSTRUCTION SHEET




ESSENZA-A17/HDL-HP-A17/HSE FRAME INSTALLATION


689-0625

PAGE 4 OF 4

WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.
RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

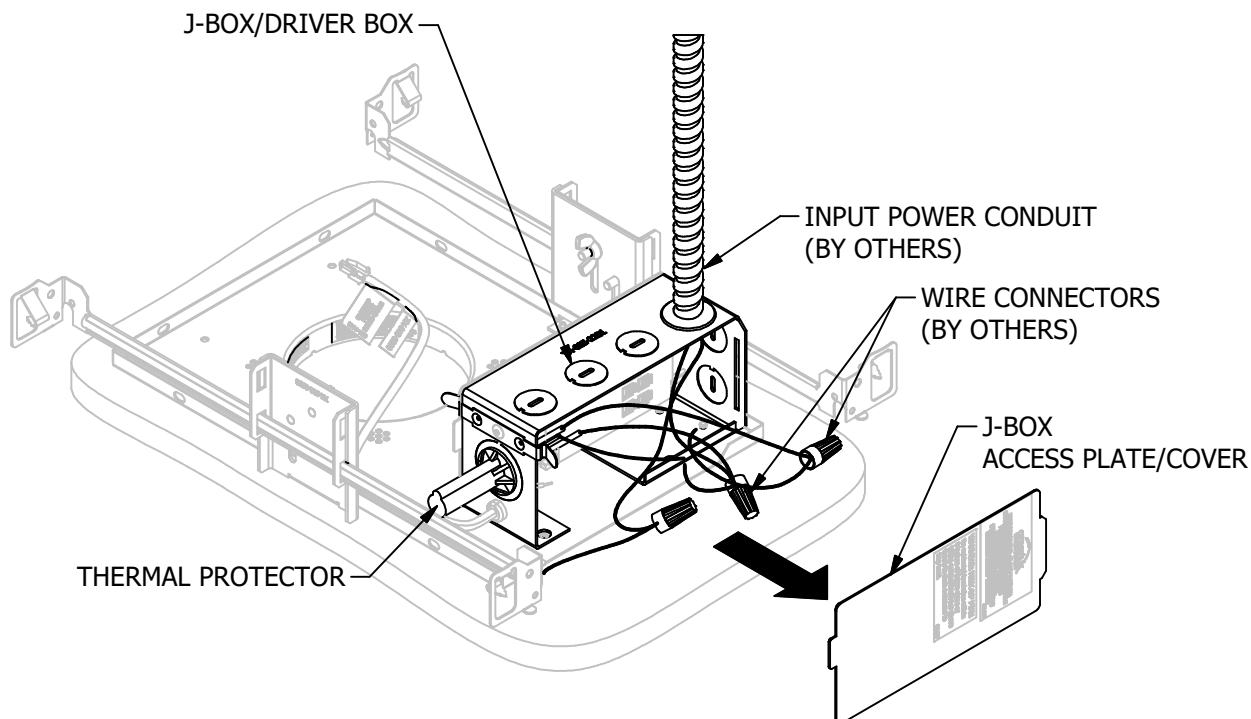

WIRING SCHEMATIC

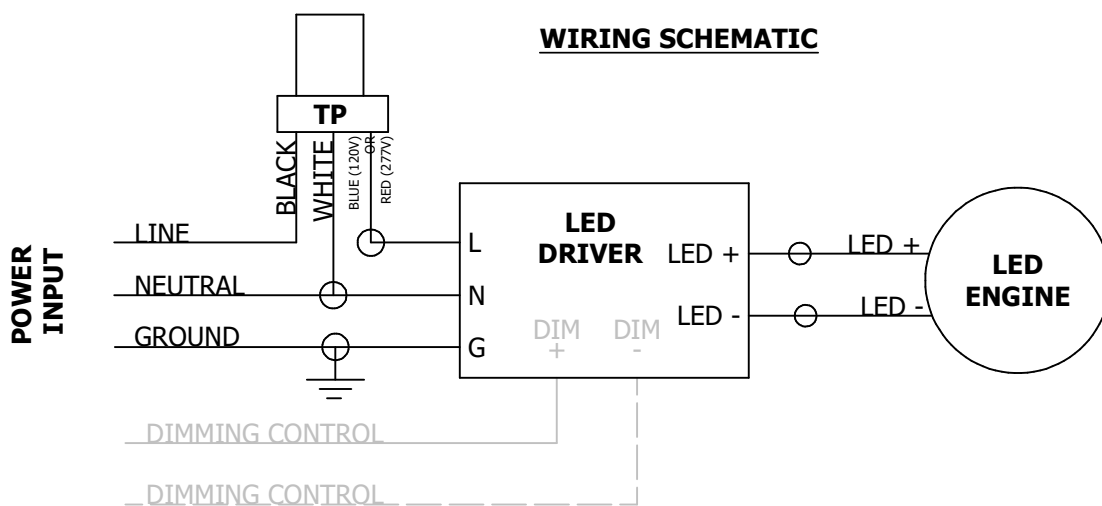

Amerlux, 178 Bauer Drive, Oakland, N.J. 07436, T: 973-882-5010, F: 973-882-2604 www.amerlux.com